



PIR MOTION SENSOR

Model: AU-X12



Celling: 12m



IP20



Sensing
area



Energy
saving



3-2000 LUX

INTRODUCTION

AutronX PIR Motion sensor is a new energy-saving switch. It adopts a good sensitivity detector and an integrated circuit. This sensor gathers automatism, convenience, safety, energy-saving, and practical functions. It utilizes the infrared energy from the human body as a control signal source and it can start the load at once when one enters the detection field. It can automatically identify day and night and is easy to install and a widely used product

TECHNICAL SPECIFICATIONS

Model	: AU-X12
Power Source	: 220-240V/AC 50Hz
Detection Range	: 360°
Detection Distance	: 12m max(<24°C)
Ambient Light	: <3-2000LUX (Adjustable)
Rated Load	: 1200W (Incandescent), 300W (LED Load)
Time Delay	: Min. 10Sec ±3Sec, Max. 15Min ±1Min
Installation Height	: Ceiling: (2.2-4m)
Power Consumption	: Approx. 0.5W
Working Temperature	: -20°C ~ +40°C
Working Humidity	: <93%RH
No. of Wires	: 3 Wires
Detection Motion Speed	: 0.6-1.5m/s

FUNCTIONAL MODES

Can identify day and night


- You can adjust the working state in different ambient lights. It can work in the daytime and at night when it is adjusted to the “sun” position (max). It can work in less than 3 LUX ambient light when adjusted on the “moon” position (min). As for the adjustment pattern, please refer to the testing pattern

Time delay is added continually


- This sensor will restart to time from the moment it receives the second induction signals within the first induction.

INSTALLATION INSTRUCTIONS

- Avoid pointing the detector towards objects with highly reflective surfaces, such as mirrors, etc.
- Avoid mounting the detector near heat sources, such as heating vents, air conditioning units, light, etc.
- Avoid pointing the detector towards objects that may move in the wind, such as curtains, tall plants, etc.
- Please move the upper cover with an anti-clockwise whirl as per the diagram on the right.
- Connect the power and the load according to the connection-wire diagram.
- Fix the bottom on the selected position with the inflated screw.
- To switch on the power and test it, install back the upper cover on the sensor

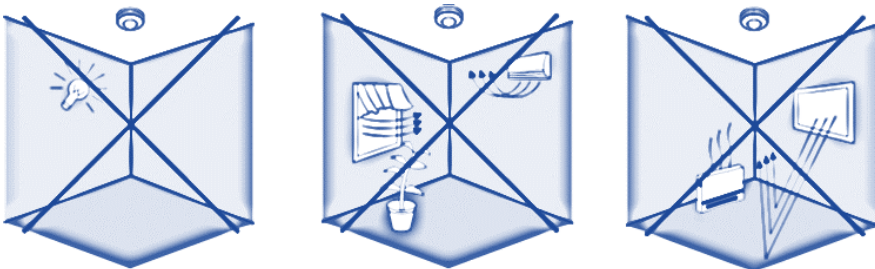


CONNECTION – WIRING DIAGRAM

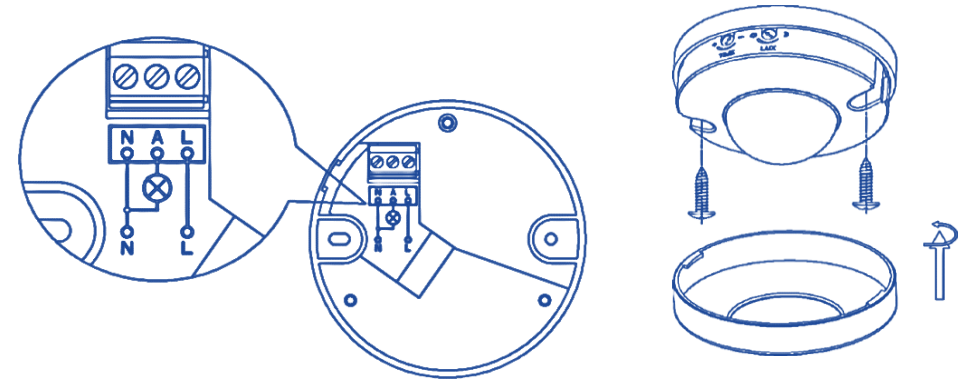

Note: When testing in daylight, please turn LUX knob to (SUN) position, otherwise the sensor could not work.

TEST


- Turn the TIME knob anti-clockwise on the minimum (-) and turn the LUX knob clockwise on the maximum (sun).
- After power is switched on, the sensor and its connected lamp will have no signal at the beginning. After a warm up of 30 seconds, the sensor can start working. The lamp will turn on if the sensor receives the induction signal. And if there is no induction signal anymore, then the load should stop working within $10\text{sec} \pm 3\text{sec}$ and the lamp would turn off.
- Turn the LUX knob anti-clockwise on the minimum (moon). The sensor would work if the ambient light is less than 3 LUX (darkness). Under no induction signal condition, the sensor should stop working within $10\text{sec} \pm 3\text{sec}$.

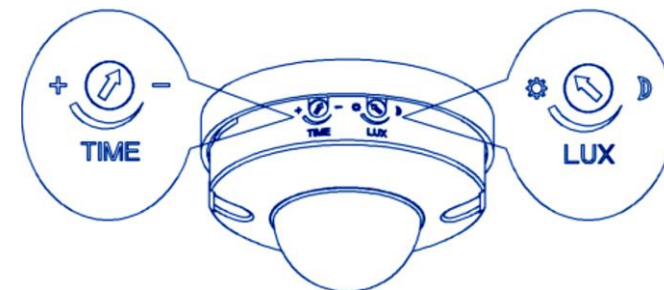


LUX FUNCTION CHECK

Daylight Function


The hold time is set to 30 seconds, and LUX is set to 300. The light switches on when it detects movement, and it switches off after 30 seconds of no movement.



When the motion is detected with sufficient daylight (>300LUX), the light remains OFF.




When the motion is detected with insufficient daylight (<300LUX), the light switches ON.



After the last detection and the present hold time-lapse (30 seconds), the light switches OFF.

No Daylight Function


The hold time is set to 30 seconds, and LUX is set to ☀ or 2000. The light switches on when it detects movement, and when people leave, it switches off after the hold time is lapsed (30 seconds).



When the motion is detected, the sensor will switch on the light to 100% brightness



After the people leave the detection area, the light remains at 100% brightness within the hold time.




After the last detection and the present hold time-lapse (30 seconds), the light switches OFF.

SAFETY INSTRUCTIONS

- An electrician or an experienced human can install it
- It cannot be installed on an uneven and shaky surface
- There shouldn't be any obstructive objects in front of the sensor that affect its detection
- Avoid installing it near the metal and glass as they may affect the sensor
- Please don't open the case if you find a hitch after the installation for your safety

DETECTION PATTEN

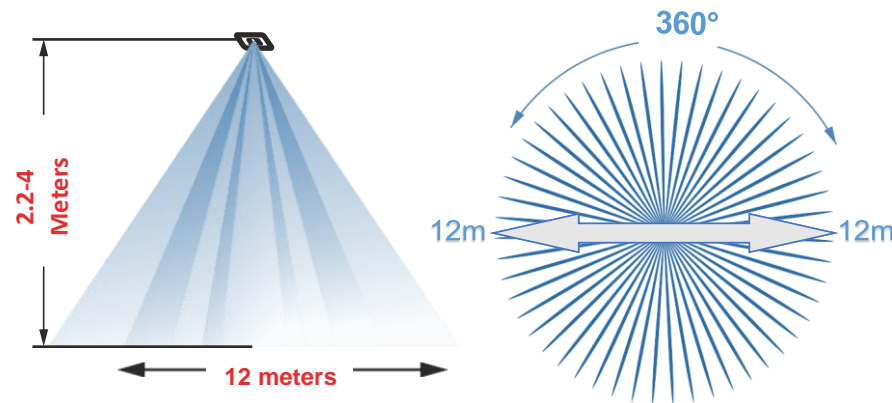

APPLICATIONS



Stairs



Lobby



Hotels



Hospital



Fire Exit

TROUBLESHOOTING

Malfunction	Cause	Remedy
The load will not work	Wrong light control is selected Faulty load The main switch is switched OFF	Adjust the setting change load Turn the switch ON
The load is always on	There is a continuous movement in the detection zone	Check the zone setting
The load will not work despite movement	The sensor is not mounted for detecting the movement reliably The movement has occurred, but the sensor does not identify it (for instance, the movement behind the wall, movement of a small object in immediate lamp vicinity, etc.)	Securely mount the enclosure Check zone setting.
The load will not work despite the movement	Rapid movements are being suppressed to minimize the malfunctioning or the detection The zone that you have set is too small	Check the zone setting